

Field Density Test Results AS1289.5.7.1


Client:	Bild Group			Job No:	BTU2343	
Project:	Ellerton Estate - Stage 1 (Level 1)			Report:	7	
Location:	Melton South					
Sample No	19	20	21			
Date Tested	26/10/2022	26/10/2022	26/10/2022			
Time Tested	AM	AM	AM			
Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.83	t/m ³ 1.85	t/m ³ 1.89			
Field Moisture Content	% 25.1	% 25.5	% 24.4			
Material:	Site Derived Clay	Site Derived Clay	Site Derived Clay			
Oversize Material	WET, % 0.0	WET, % 0.0	WET, % 0.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.85	t/m ³ 1.85	t/m ³ 1.91			
Optimum Moisture Content	% 26	% 26	% 25			
Moisture Ratio	% 96.5	% 98	% 97.5			
Moisture Variation from OMC	% -0.5 Drier	% -0.5 Drier	% -0.5 Drier			
Density Ratio	% 99.0	% 99.5	% 99.0			

Specification:	98% STD	Test Selection:	N/A
Notes:	Ref : 1120 0347-1 (SI07)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 <p>NATA WORLD RECOGNISED ACCREDITATION</p>	<p>NATA Accredited Laboratory No. 20172 Accreditation for compliance with ISO/IEC 17025 - Testing The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards</p>	<p>Approved Signatory:</p> <div style="text-align: center;">  David Burns </div>	<p>Date:</p> <div style="text-align: center;"> 3/11/2022 </div>
---	--	--	---



Test Location

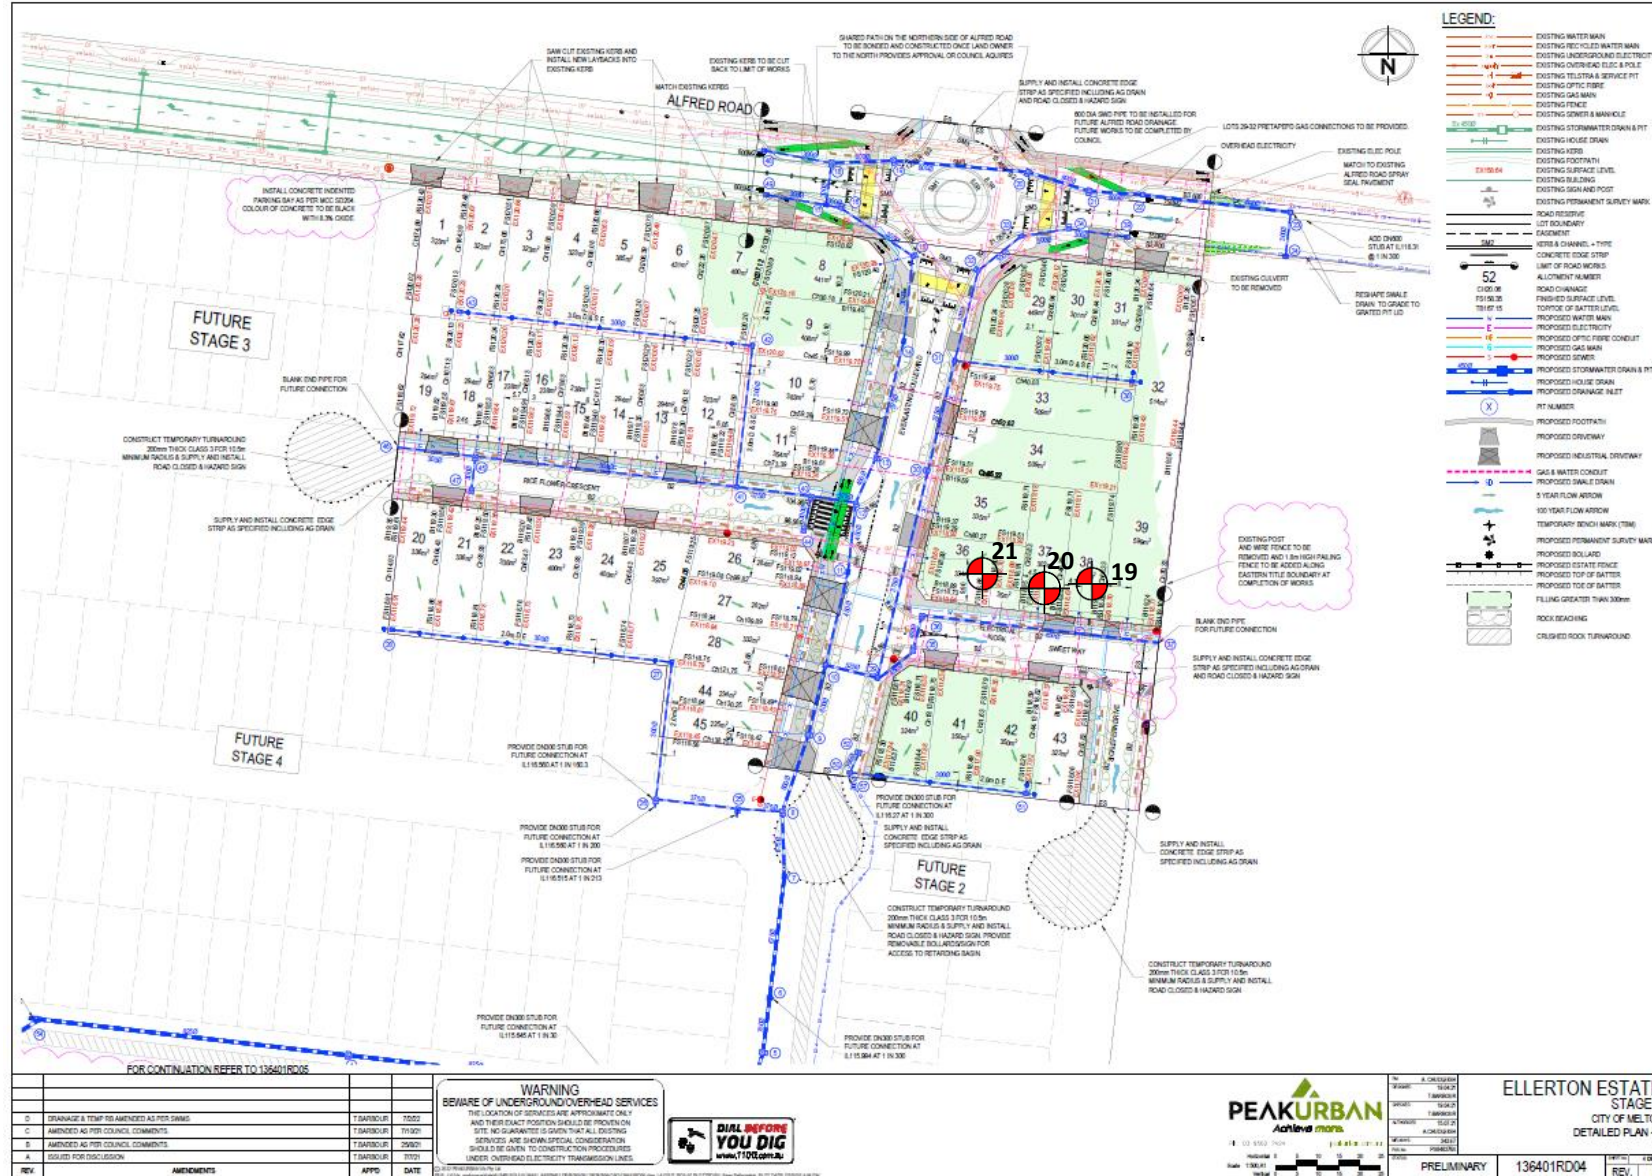

PROJECT:
Ellerton Estate – Stage 1 (Level 1)

CLIENT:
Bild Group

DATE:
26/10/2022

LOCATION:
Melton South

PROJECT No.:
1120 0347-1 (S107)

SITE PLAN SKETCH—NOT TO SCALE

